


Water Section

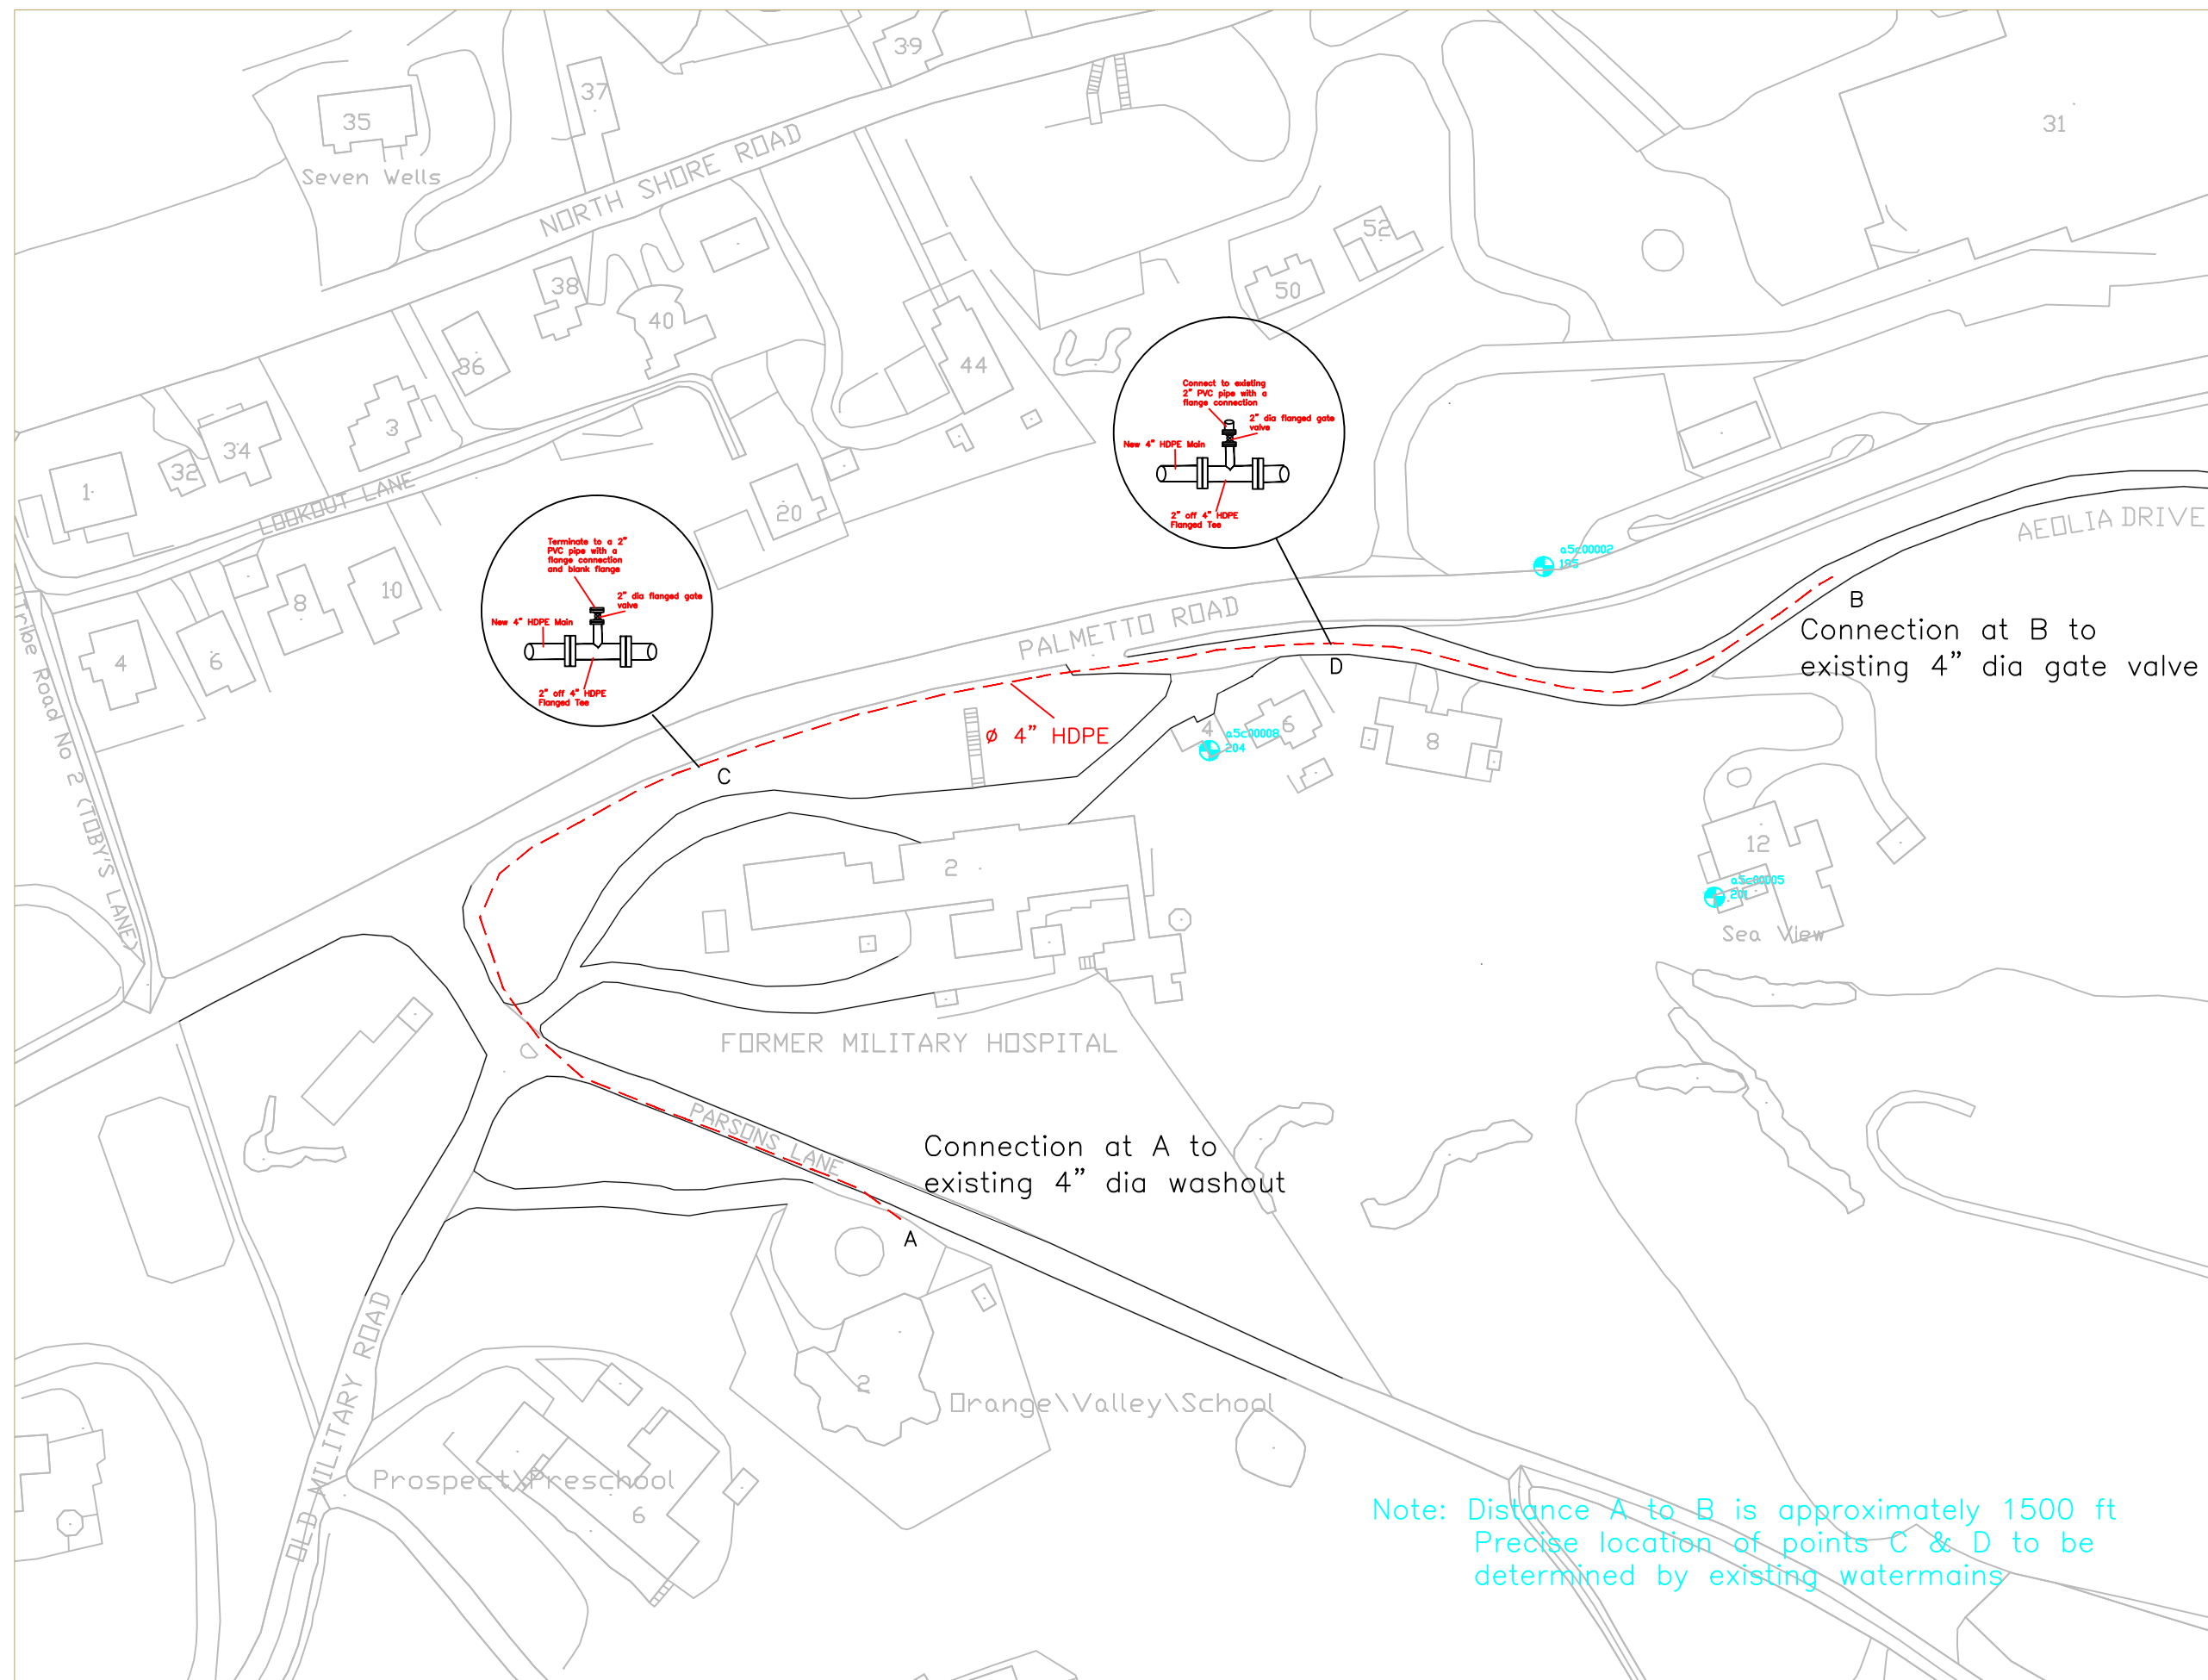

B
Connection at B to
existing 4" dia gate valve

A
Connection at A to
existing 4" dia washout

Note: Distance A to B is approximately 1500 ft
Precise location of points C & D to be
determined by existing watermains

ISSUED FOR: TENDER June 2016

AMENDMENTS:

NO:	REVISION	APP	DATE:

SCALE: N/A

SURVEY
PREPARED BY: NA DATE: NA

DESIGN
PREPARED BY: KC DATE: 26/05/16
CHECKED BY: DATE: 26/05/16

DRAWING
PREPARED BY: KC DATE: 26/05/16
CHECKED BY: DATE:

APPROVED BY:

PROJECT NUMBER:

PROJECT NAME:
**AEOLIA DRIVE
WATER SUPPLY**

DEVONSHIRE
DRAWING FILE NO: ACAD R-14

SHEET TITLE:

SITE PLAN

SHEET NUMBER: AD01 REVISION: 1