



3-2" outlets from septic tank pipe inverts must be at same elevation

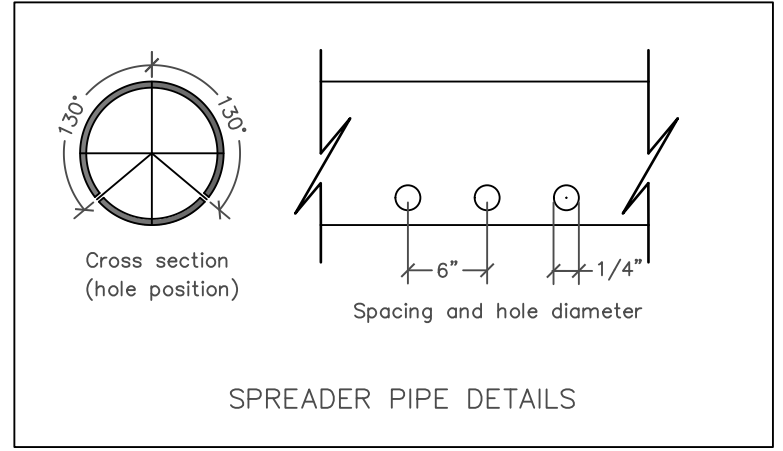

24" x24" access cover
3-2" outlets from septic tank pitched 1/4" per foot

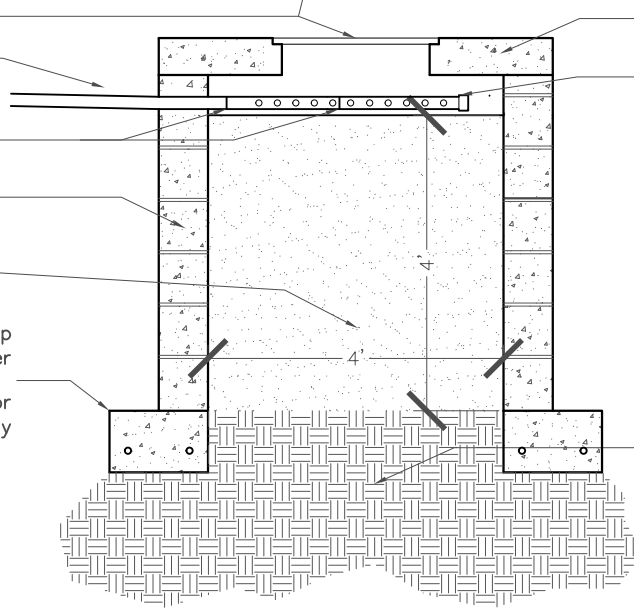

6" concrete reinforced top slab
4" effluent discharge pipe connected to 3 - 2" perforated spreader pipes for even flow over the filter bed

joints for disassembly
8" filled concrete block
clean, sifted construction sand (no beach sand)

footings 16" x 10" deep
2 -12mm bars with min. 3" cover
Note: footings approved for 4' x 3' x 4' sand filter only

NOTE:
Joints to spreaders to be tight but not glued.

1 Sand Filter
Scale: not to scale